JL181

Unit:mm

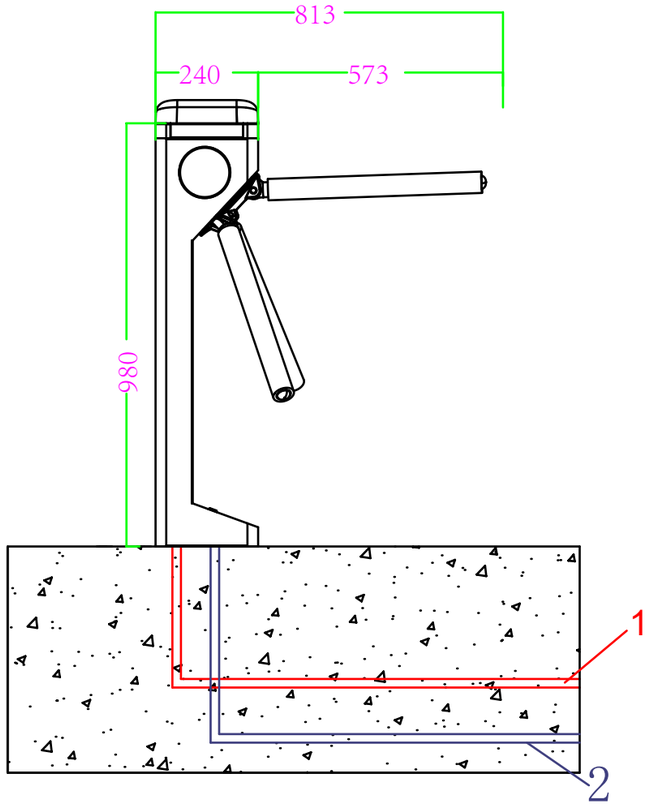

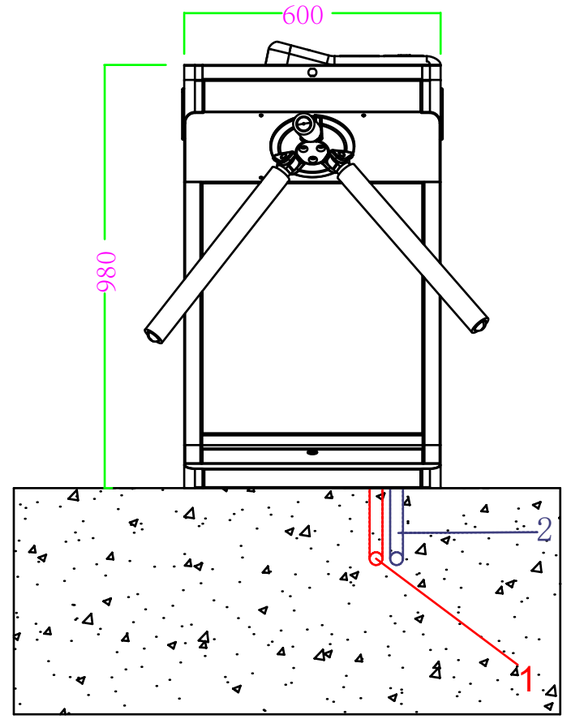

V1.7

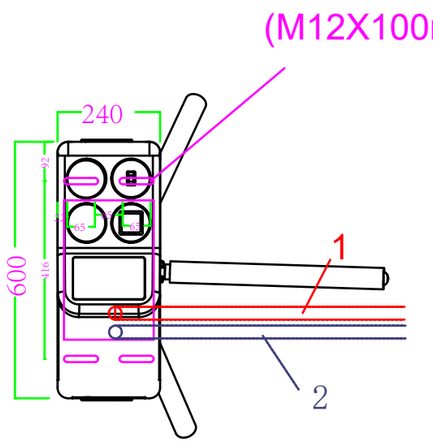

Installation Manual:

1	‖	The Ø20mm PVC tube for AC 220V Power wires(3 X Ø2.0mm).
2	‖	TCP/IP ethernet cable for connecting access device to PC.
3	▯	Control board .
4	H	Fixing the equipment with M12 X 100mm expansive bolt .

Mark:All wires extending out of the ground shall be no less than 2M.